
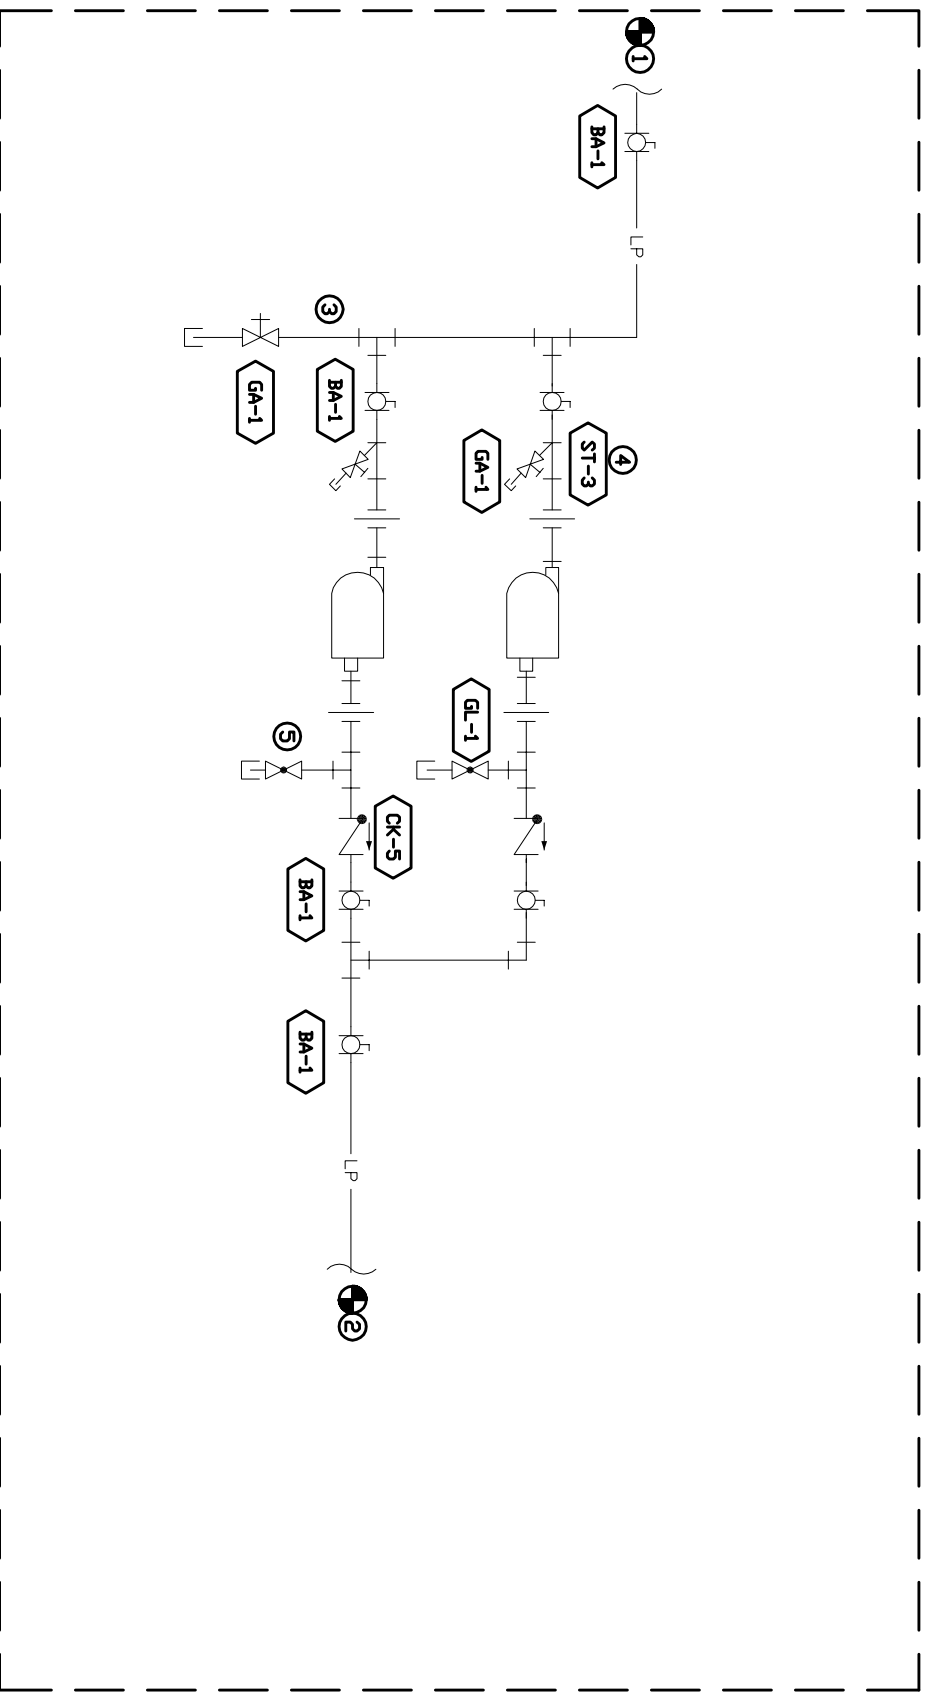



- # KEY NOTES:**
1. CONDENSATE PDC.
 2. CONDENSATE PDC.
 3. DIRT TRAP.
 4. WYE STRAINER SHALL HAVE 0.033 PERF. MESH SCREEN.
 5. TEST TEE

GENERAL NOTES:
 1. EQUIPMENT AND MATERIALS SHALL COMPLY WITH APPLICABLE UNIVERSITY STANDARDS.

PIPE SYMBOLS

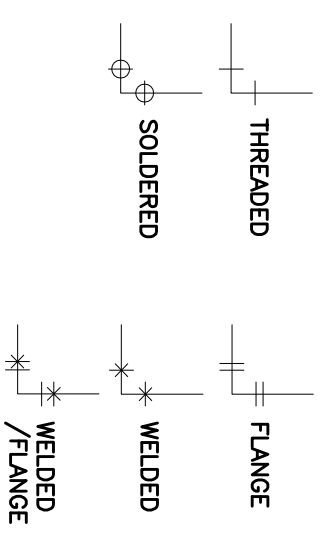

1 STEAM TRAP FOR LP BLDG SYSTEMS
 SCALE: NTS



Yale University
 Facilities Planning & Construction
 Standard Detail

DETAIL TITLE:
 CONDENSATE STEAM TRAP LP
 BLDG SYSTEMS

CAD DETAIL NO.:
 SD232216-01

DATE: 01/10/2025
SCALE: N.T.S.
BY: MGL