
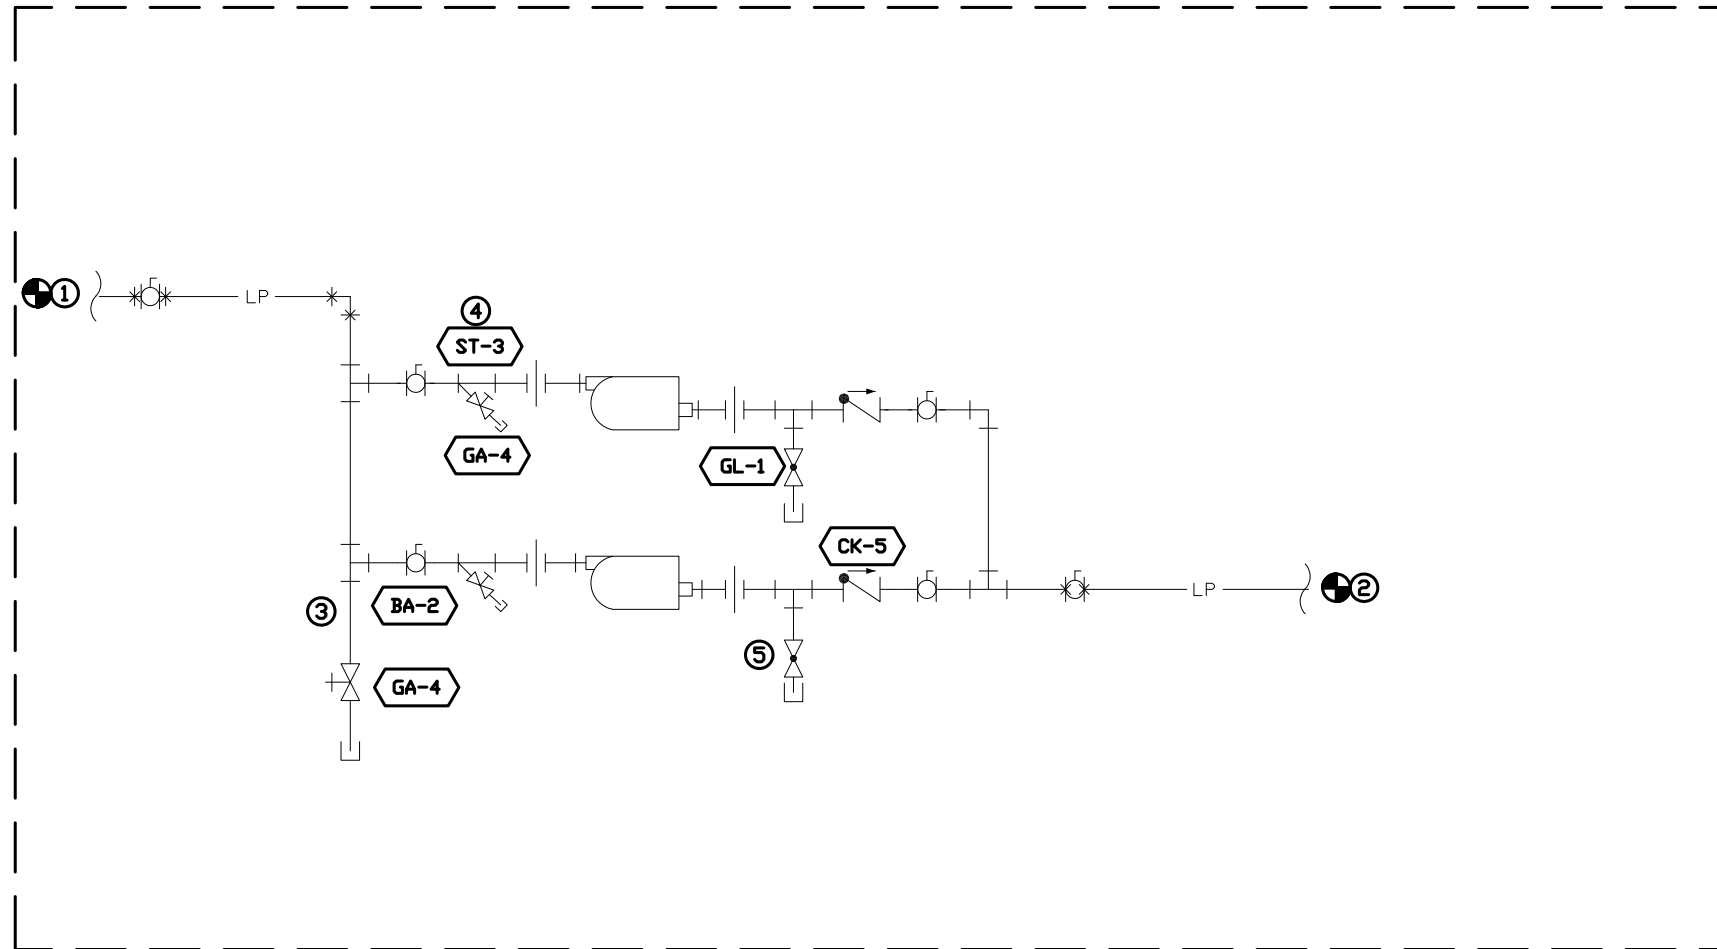



- # KEY NOTES:
1. CONDENSATE POC.
 2. CONDENSATE POC.
 3. DIRT TRAP.
 4. WYE STRAINER SHALL HAVE 0.033 PERF. MESH SCREEN.
 5. TEST TEE

- GENERAL NOTES:
1. EQUIPMENT AND MATERIALS SHALL COMPLY WITH APPLICABLE UNIVERSITY STANDARDS.

PIPE SYMBOLS

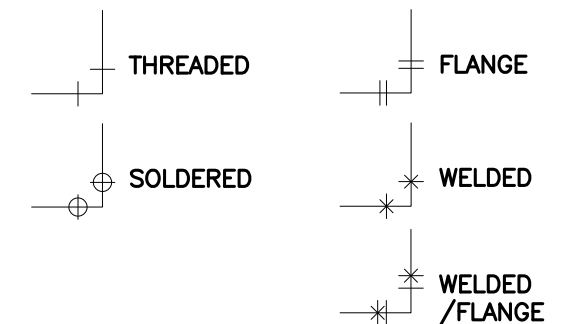

1 STEAM TRAP FOR LP BLDG SYSTEMS
SCALE: NTS



Yale University
Facilities Planning & Construction
Standard Detail

DETAIL TITLE:
CONDENSATE STEAM TRAP LP
BLDG SYSTEMS

CAD DETAIL NO.:
SD232216-01

DATE: 01/16/2019
SCALE: N.T.S.
BY: MGL